

Fayette Water Supply Corporation

P.O. Box 724
200 Bordovsky Rd
La Grange, TX 78945

Office (979) 968-6475
Fax (979) 968-8239
www.fayettewsc.com

Pressure Reducer Valves (PRV) & Member Cut-Off Valves Effective November 1, 2017

Effective November 1, 2017, FWSC no longer installs a PRV or a member cut-off valve. **As of November 1, 2017, Members with existing PRVs or Member cut-off valves are responsible for repair/replacement of this equipment.**

In Section E of the FWSC Tariff: Service Rules and Regulations, the Corporation's ownership and maintenance responsibility of water supply and metering shall end at the meter. Therefore, all water usage registering upon and/or damages occurring to the metering equipment owned and maintained by the Corporation shall be subject to charges as determined by the Corporation's Tariff as amended from time to time by the Board of Directors.

The Corporation **requires** each Member to have a cut-off valve within two feet of the meter on the Member's side of the meter for purposes of isolating the Member's service line. The valve must meet American Water Works Association standards, a ball valve is preferred. The Member's use of FWSC's angle stop valve or another similar valve is prohibited. Any damage to FWSC's equipment shall be subject to service charges.

FWSC's Service Application and Agreement states that FWSC is not liable for damages caused by service interruptions, events beyond its control, and for normal system failures. The limits of liability of the Corporation are the extent of the cost of service provided. By acceptance of Membership, the Member consents to waiver of such liability.

Do I need a Pressure Reducer Valve (PRV)?

As stated in FWSC's Service Application and Agreement, FWSC is **not** responsible for any damage to Member's property due to water pressure. Due to circumstances beyond FWSC's control, water pressure may fluctuate. Therefore, it is recommended that all properties have a PRV installed to prevent any damage to pipes and/or appliances. The Member can attach their own PRV or have a licensed plumber do so. Typically, the PRV is factory set to 55PSI, but can be adjusted. It is not recommended for the pressure to exceed 80PSI.


If you have any questions regarding this notice, please do not hesitate to call the FWSC Office at (979) 968-6475.

Thank you,



James Rebeck
General Manager

Dividing Line

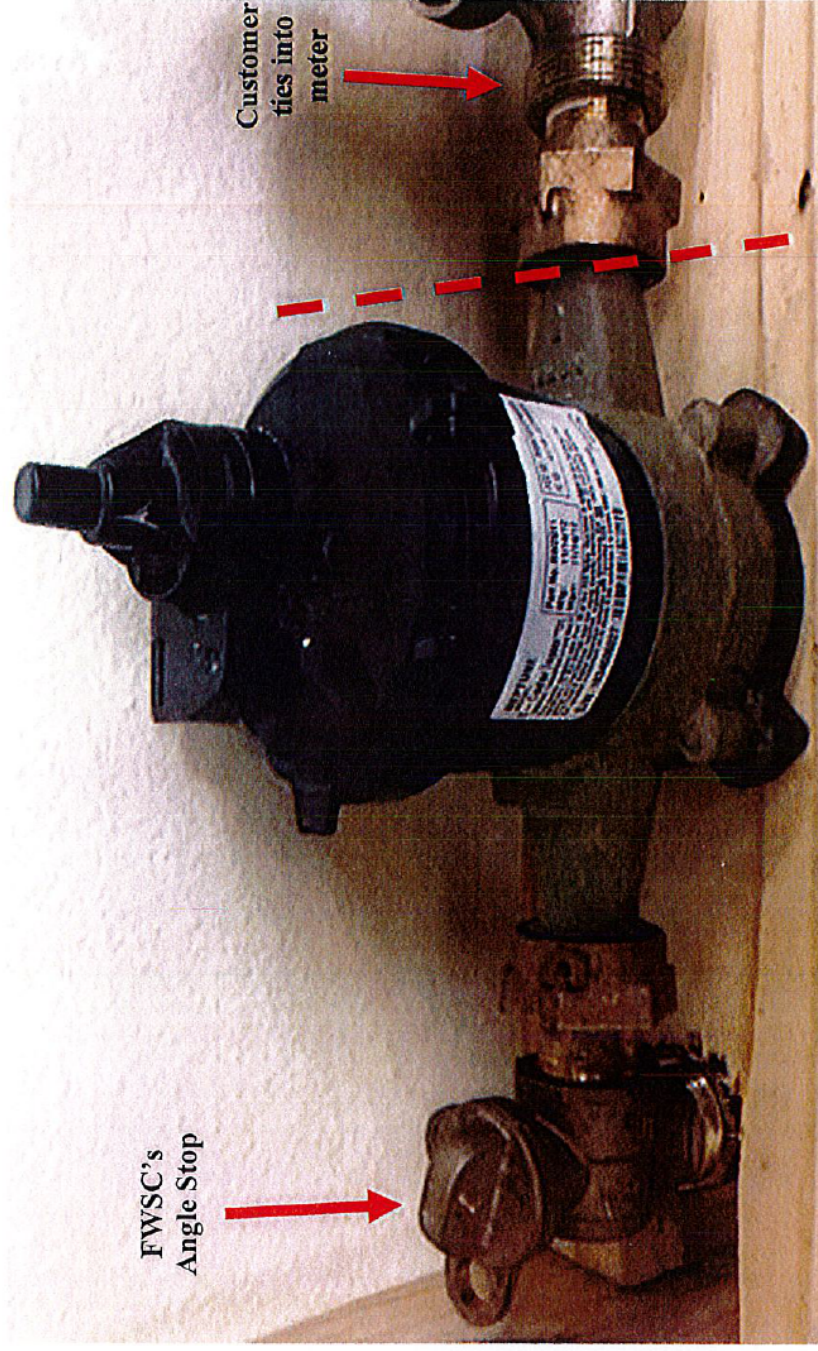

FWSC's
Angle Stop

Customer
ties into
meter

Customer is
required to install a
personal cut off
valve about two feet
after the meter.

FWSC Responsibility

Customer Responsibility